

LINETRAXX® MRCD410R

Single-channel AC and pulsed DC sensitive
modular residual current device for AC systems



Intended Use

Modular residual current devices of type MRCD410R are designed for AC and pulsed DC residual and fault current measurement in earthed TN and TT networks. The devices can be used as an additional protective measure for the following protection goals, among others:

- Protection against indirect contact (DIN VDE 0100-410, IEC60364-4-41)
- Protection against thermal effects (DIN VDE 0100-420, IEC60364-4-42)
- System protection (DIN VDE 0100-430, IEC60364-4-43)

According to IEC 60364-5-53 and DIN VDE 0100-530, it is intended for use in earthed power supplies (TN and TT systems).

Please note that the standards mentioned may contain further requirements for use.

A modular fault current device according to product standard IEC60947-2 Annex M is completed by a measuring current transformer designed for this purpose and a circuit breaker with undervoltage release (device combination).

**ADVICE**

According to the product standard IEC60947-2 Annex M.7.1, it must only be possible to adjust the response value by means of an intentional action. This requires a cover that can be sealed.

The supplied sealing cover must be installed!

Suitable measuring current transformers are listed in the technical data. The switching time of the circuit breaker with undervoltage release incl. tripping device under load must not exceed 20 ms.

The requirements of the system and operating conditions on site and the application must be taken into account by selecting a suitable device combination and individual parameterisation. Furthermore, the notes, instructions and specifications in this manual must be observed and implemented.

The devices are intended for operation in control cabinets or similarly protected environments.

For intended operation, observe the specifications in this manual. Any other use than that described in this manual is regarded as improper.

Device features

- AC and pulse current sensitive residual current monitoring module for MRDC applications according to **DIN EN IEC 62020-1, Type A**
- Root mean square measurement (RMS)
- Residual operating current: 10 mA...30 A (42...70 Hz)
- Prewarning: 50...100 % of residual operating current
- Supply voltage DC 24 V, optional AC/DC 100...240 V (MRCD410R-2 only)
- LED-strip measured value display
- Adjustable response delay
- Alarm relay (designed as changeover contact)
- Non-fail-safe current/fail-safe current principle and fault memory behaviour selectable
- RS-485 with Modbus RTU
- Continuous CT-connection monitoring
- NFC interface for device parameter setting with the device energised or de-energised

Wiring diagram


Control via undervoltage release (Fail-safe mode)

i To comply with IEC 60947-2 Annex M, the MRCD410R must be operated in connection with a circuit breaker with undervoltage release or operating current release in fail-safe relay mode. The circuit breaker must comply with the IEC 60947-2 standard and be capable of switching off in less than 20 ms.

We recommend operating the signalling relay K in the **Fail-safe** mode. This allows the failure of the supply voltage and the failure of the internal power supply to be detected and reported.

The following settings need to be configured:

Modbus register	Parameter	Setting	Factory setting
32101	Relay mode	Fail-safe	Fail-safe
32200	Start with Alarm	Enabled	Enabled

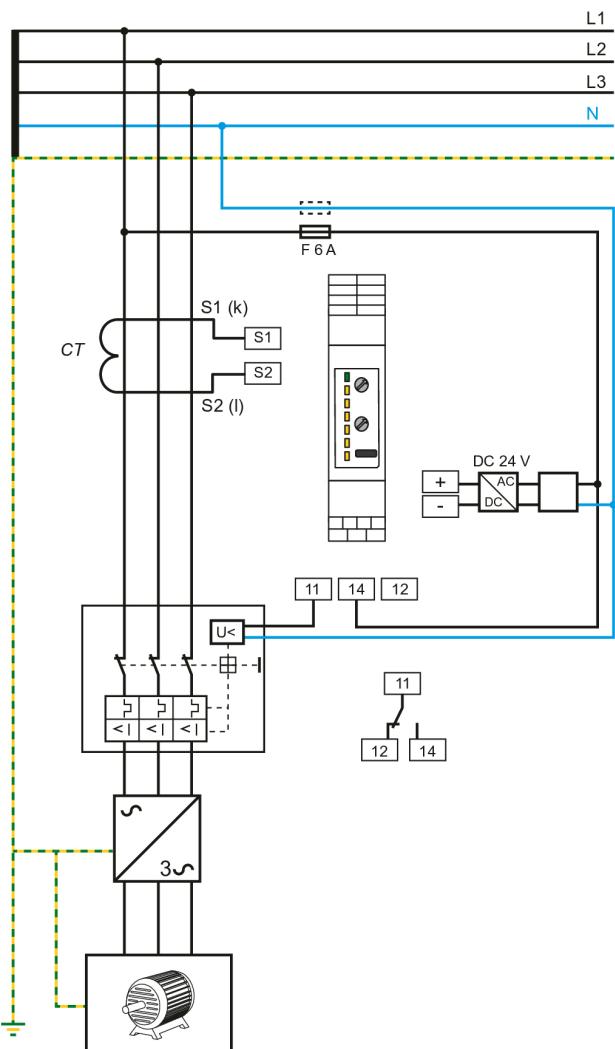

Wiring diagram with undervoltage release

A MRCD410R-2 can alternatively be connected via terminals A1/A2 with AC/DC 100...240 V.

ADVICE

! The supply voltage of the device must always be taken before the circuit breaker.


Control via shunt release (Non-fail-safe mode)

For economic installation reasons, the relay K can be operated in **Non-fail-safe mode**. Due to this relay mode, it is important to minimise risk by ensuring that the test intervals are carried out at shorter intervals based on a risk assessment.

In general, when applying the **Non-fail-safe mode** in the context of risk assessment, a concept must be developed for dealing with an interruption in the supply voltage to the MRCD410R.

The following settings need to be configured:

Modbus register	Parameter	Setting	Factory setting
32101	Relay mode	Non-fail-safe	 ADVICE <i>Manual adjustment required!</i>
32200	Start with Alarm	Disabled	 ADVICE <i>Manual adjustment required!</i>

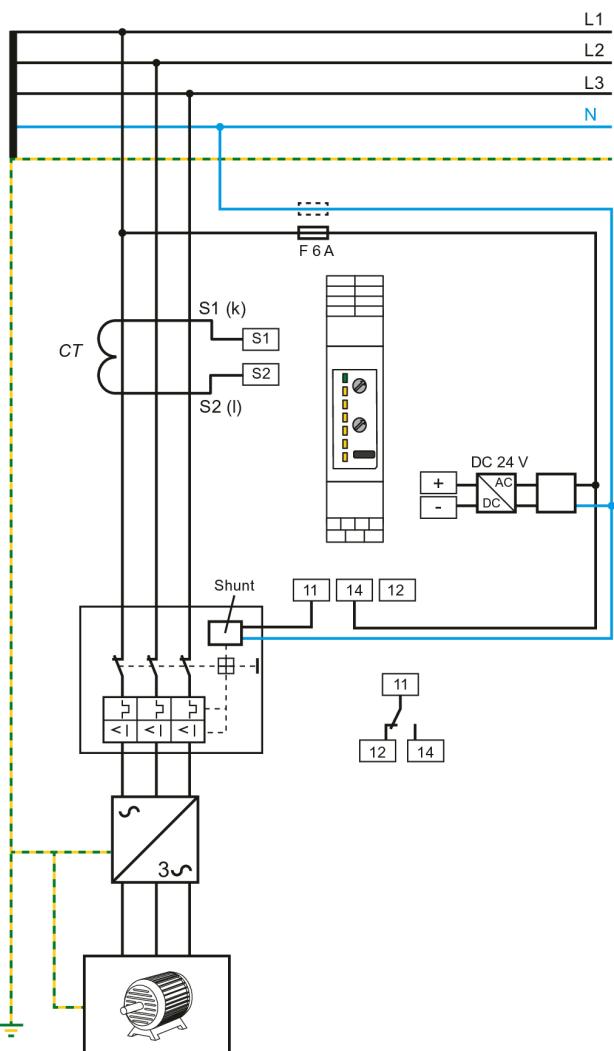





Wiring diagram with shunt release

A MRCD410R-2 can alternatively be connected via terminals A1/A2 with AC 100...240 V.



ADVICE
The supply voltage of the device must always be taken before the circuit breaker.

Connections overview

		Terminal	Connection
Top	 <p>MRCD410R-2</p>	A1, A2	Supply voltage U_s
	 <p>MRCD410R-24</p>	S1, S2	Measuring current transformer
Bottom		+	DC 24 V
		-	
		A	RS-485 A - Modbus RTU
		B	RS-485 B - Modbus RTU
		11, 14, 12	Alarm relay K1

NFC interface



The NFC interface can be used to transmit a previously configured device parameter setting directly to the device.



i This function is available only via the Bender Connect App. You can find this app in the App stores for iOS and Android.



In the Bender Connect app the device first needs to be made known. Then the device-specific setting options are shown so that they can be configured. When the data is transferred, feedback is given whether the parameter configuration has been successful.

Parameter settings can be transmitted to the device via the Bender Connect app by holding the mobile phone close to the device.

To a **de-energised** device, a parameter setting can be transferred via the Bender Connect app. This setting is then activated automatically when the device is connected to the current supply.


When a device is **plugged in**, too, parameters can be configured via the Bender Connect App. To this end, the NFC interface first needs to be activated in the device.

The NFC interface is activated via the T/R button at the front of the device or via the Modbus interface.

The NFC antenna is located at the front on the righthand side of the MRCD410R.

Dimension diagrams

Dimensions in mm

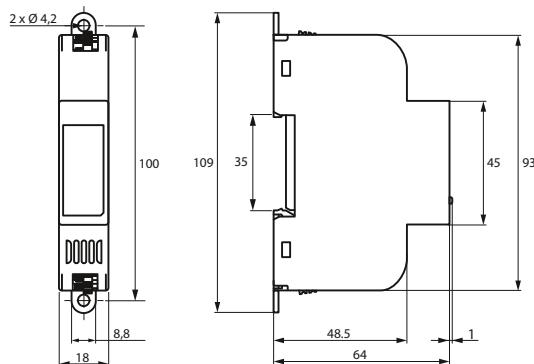

Technical data

(*) = Factory setting

Insulation coordination (IEC 60664-1 / IEC 60664-3)

MRCD410R-24

Definitions

Measuring & control circuit (IC1)	S1, S2, +, -, A, B
Output circuit (IC2)	11, 12, 14
Rated voltage	250 V
Overvoltage category	III
Operating altitude	≤ 2000 m AMSL
Rated impulse voltage	
IC1/IC2	4 kV
Rated insulation voltage	
IC1/IC2	250 V
Pollution degree	2
Protective separation (reinforced insulation) between	
IC1/IC2	300 V
Voltage test (routine test) acc. to IEC 61010-1	
IC1/IC2	AC 2.2 kV

MRCD410R-2

Definitions

Supply circuit (IC1)	A1, A2
Output circuit (IC2)	11, 12, 14
Measuring & control circuit (IC3)	S1, S2, +, -, A, B
Rated voltage	250 V
Overvoltage category	III
Operating altitude	≤ 2000 m AMSL
Rated impulse voltage	
IC1/(IC2-3)	4 kV
IC2/IC3	4 kV
Rated insulation voltage	
IC1/(IC2-3)	250 V
IC2/IC3	250 V
Pollution degree	2
Protective separation (reinforced insulation) between	
IC1/(IC2-3)	300 V
IC2/IC3	300 V
Voltage test (routine test) acc. to IEC 61010-1	
IC1/(IC2-3)	AC 2.2 kV
IC2/IC3	AC 2.2 kV

Supply voltage

MRCD410R-2, MRCD410R-24

Connection	+, -
Supply voltage U_s	DC 24 V
Tolerance of U_s	-30...+25 %
Power consumption	≤ 2 W
Inrush current (< 5 ms)	< 10 A

Supply voltage

MRCD410R-2

Connection	A1, A2
Supply voltage U_s	AC/DC 100...240 V (47...63 Hz)
Tolerance of U_s	±15 %
Power consumption	≤ 2 W / ≤ 3.5 VA
Inrush current (< 2 ms)	< 1.8 A

Measuring circuit

Burden (internal)	33 Ω
Frequency range	42...70 Hz
Measuring current transformer monitoring ¹⁾	On/off (on)*
Measuring range (peak)	2 mA...70 A
Measuring range rms	2 mA...50 A
Rated residual operating current	30 A
Response value main alarm/ $I_{\Delta n}$ ¹⁾	10 mA...30 A (30 mA)*
Prewarning ¹⁾	50...100 % $\times I_{\Delta n}$ (70 %)*
Operating uncertainty	±10 % (at 0.5...5 $\times I_{\Delta n}$)
Relative response uncertainty	6 mA...20 A: -20...0 % 20...30 A: -50...0 %
Rated thermal short-term current	2.4 kA/1 s
Hysteresis ¹⁾	10...25 % (15 %)*
Fault-memory alarm messages	On/off (on)*

¹⁾ Can only be configured via RS-485

Measuring current transformers

Connection	CT (S1, S2)
Measuring-current transformer series, type A ¹⁾	CTAC... series
CT connection monitoring	Yes
Rated voltage U_n	See technical data of the measuring current transformer
Rated surge current	6.0 kA/40 ms
Connecting cables	See technical data of the measuring current transformer
Cable lengths	
Single wire $\geq 0.75 \text{ mm}^2$	0...1 m
Single wire, twisted $\geq 0.75 \text{ mm}^2$	0...10 m
Shielded cable $\geq 0.75 \text{ mm}^2$	0...40 m

¹⁾ For a selection of suitable measuring current transformers, see chapter "Measuring current transformer connection" in the manual

Time response

Start-up delay t	0...900 s (0 s)*
Response delay t_{on}	
$I_{\Delta n} \leq 30 \text{ mA}$	0 s
$I_{\Delta n} > 30 \text{ mA}$	0...10 s (0 s)*
Delay on release t_{off}	0...900 s (0 s)*
Operating time t_{ae}	
with $1 \times I_{\Delta n}$	≤ 180 ms
with $2 \times I_{\Delta n}$	≤ 130 ms
with $5 \times I_{\Delta n}$	≤ 20 ms
with $10 \times I_{\Delta n}$	≤ 20 ms
Response time t_{an}	$t_{\text{an}} = t_{\text{ae}} + t_{\text{on}}$
Recovery time t_b	≤ 500 ms
Response time for CT connection monitoring	≤ 5 s

Operation

Display	Status LED incl. LED bar graph
Display range, measured value	25 / 50 / 75 / 100 %
Button T/R	Reset / test / NFC / address setting

RS-485 interface

Connection	A, B
Protocol	Modbus RTU
Baud rate	Max. 115.2 kbit/s (19.2 kbit/s)*
Parity	even, no, odd (even)*
Stop bits	1/2/auto (auto)*
Cable length (at 9.6 kbit/s)	≤ 1200 m
Recommended lines, shield on one side connected to PE	
CAT6/CAT7 min. J-Y(St)Y 2 x 0.6 mm ²	Min. AWG23 Twisted pair
Required terminating resistor	120 Ω (> 0.25 W)
Device address	1...247 (100 + last two digits of serial number)*

NFC interface

Frequency	13.56 MHz
Transmitting power (modulating; in 0 m distance, e.g.) ¹	0 W

¹

- EMC influences may lead to communication interruptions at the NFC interface.
- The device does not transmit any radio waves when used as intended.

Switching elements

Relay	1 changeover contact
Connection	11, 12, 14
Operating principle	Fail-safe or Non-fail-safe (Fail-safe)*
Electrical endurance, number of cycles	10000

Contact data acc. to IEC 60947-5-1

Utilisation category	AC-13 / AC-14 / DC-12 / DC-12 / DC-12
Rated operational voltage	230 V / 230 V / 24 V / 110 V / 220 V
Rated operational current	5 A / 3 A / 1 A / 0.2 A / 0.1 A
Minimum contact load	
Relay manufacturer's reference (Refers to relays that have not been operated with high contact currents.)	10 mA/5 V DC

EMC/Environment

EMC	DIN EN IEC 62020-1
Operating temperature	-25...+55 °C
Transport	-40...+85 °C
Long-time storage	-40...+70 °C

Classification of climatic conditions acc. to IEC 60721

Stationary use (IEC 60721-3-3)	3K22
Transport (IEC 60721-3-2)	2K11
Long-term storage (IEC 60721-3-1)	1K22

Classification of mechanical conditions acc. to IEC 60721

Stationary use (IEC 60721-3-3)	3M11
Transport (IEC 60721-3-2)	2M4
Long-term storage (IEC 60721-3-1)	1M12

Connection

Terminals	Push-In
Connection properties	
rigid	0.2...1.5 mm ² (AWG 24...16)
flexible	0.2...1.5 mm ² (AWG 24...16)
with ferrule with plastic sleeve	0.25...0.75 mm ²
with ferrule without plastic sleeve	0.75...1.5 mm ² (Use crimping pliers similar to CRIMPFOX 6 / Weidmüller PZ6/PZ6/5 only)
Stripping length	8 mm

Other

Operating mode	Continuous operation
Mounting	Vertical
Degree of protection (DIN EN 60529)	
terminals	IP20
internal components	IP30
Enclosure material	Polycarbonate
DIN rail mounting acc. to	IEC 60715
Flammability class	UL94 V-0
Weight	
MRCD410R-24	≤ 60 g
MRCD410R-2	≤ 70 g

Approvals

Standards & certifications

The MRCD410R device has been developed in accordance with the following standards:

- DIN EN IEC 60947-2
- UL508



Licences

For a list of the open-source software used see our [Homepage](#).

Declaration regarding the radio system

EU declaration of conformity

Bender GmbH & Co. KG hereby declares that the device covered by the Radio Equipment Directive complies with Directive 2014/53/EU. The full text of the EU Declaration of Conformity is available at the following internet address:

[EU declaration of conformity MRCD410R](#)

Hereby, Bender GmbH & Co. KG declares that this radio equipment complies with Radio Equipment Regulations 2017 (SI. 2017/1206). The full text of the UK declaration of conformity is available at the following internet address:

[UKCA-Declaration of Conformity MRCD410R](#)

Ordering information

Type	Supply voltage U_s	Measuring current transformers that can be used		Art. No.
		Type A	Type B	
MRCD410R-24	DC 24 V	X		B74602020
MRCD410R-2	DC 24 V AC/DC 100...240 V	X		B74603020


Accessories	Art. No.
Sealable transparent cover (spare part)	B80609199



Bender GmbH & Co. KG

Londorfer Straße 65
35305 Grünberg
Germany

Tel.: +49 6401 807-0
info@bender.de
www.bender.de



© Bender GmbH & Co. KG, Germany
Subject to change!

The specified standards take into account the edition valid until 12.2025 unless otherwise indicated.